



GENERAL NOTES

ALL WORK SHALL CONFORM TO THE APPLICABLE SECTIONS OF THE SPECIFICATIONS ENTITLED "STANDARD SPECIFICATIONS, STATE OF CALIF-ORNIA, BUSINESS AND TRANSPORTATION AGENCY, DEPARTMENT OF TRANSPORTATION", AND IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, AND THESE SPECIAL PROVISIONS.

LUMINAIRE SHALL BE LIGHT EMITTING DIODE TYPE, LEDWAY STREETLIGHT TYPE III MEDIUM, AS MANUFACTURED BY BETALED, OR APPROVED EQUAL. BETALED CATALOG# STR-LWY-3M-HT-03-C-UL-SV-R, OR APPROVED EQUAL, SHALL BE CONSIDERED EQUIVALENT TO A 70 WATT HIGH PRESSURE SODIUM LUMINAIRE. BETALED CATALOG# STR-LWY-3M-HT-04-C-UL-SV-R, OR APPROVED EQUAL, SHALL BE CONSIDERED EQUIVALENT TO A 150 WATT HIGH PRESSURE SODIUM LUMINAIRE.


ALL STREET LIGHTS SHALL BE NUMBERED. NUMERICAL SEQUENCE TO BE OBTAINED FROM P.G.&E. NUMBERS TO BE 1 1/2" HIGH AND INSTALLED NINE FEET ABOVE FINISHED GRADE, FACING STREET.

A PULL BOX WILL BE REQUIRED WHEREVER CONDUIT CHANGES DIRECTION AND WHERE MULTIPLE LIGHTS ARE INSTALLED ON A SINGLE SERVICE. PULLBOX SPACING SHALL NOT EXCEED 200'. (SEE P.W. STD. E-4)

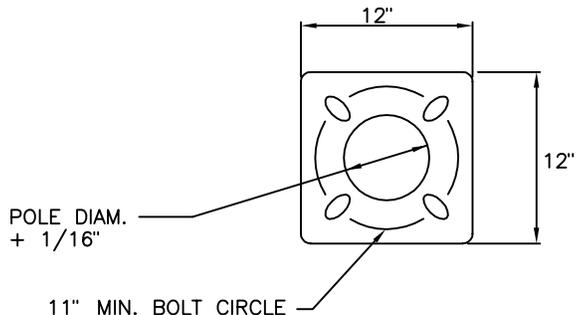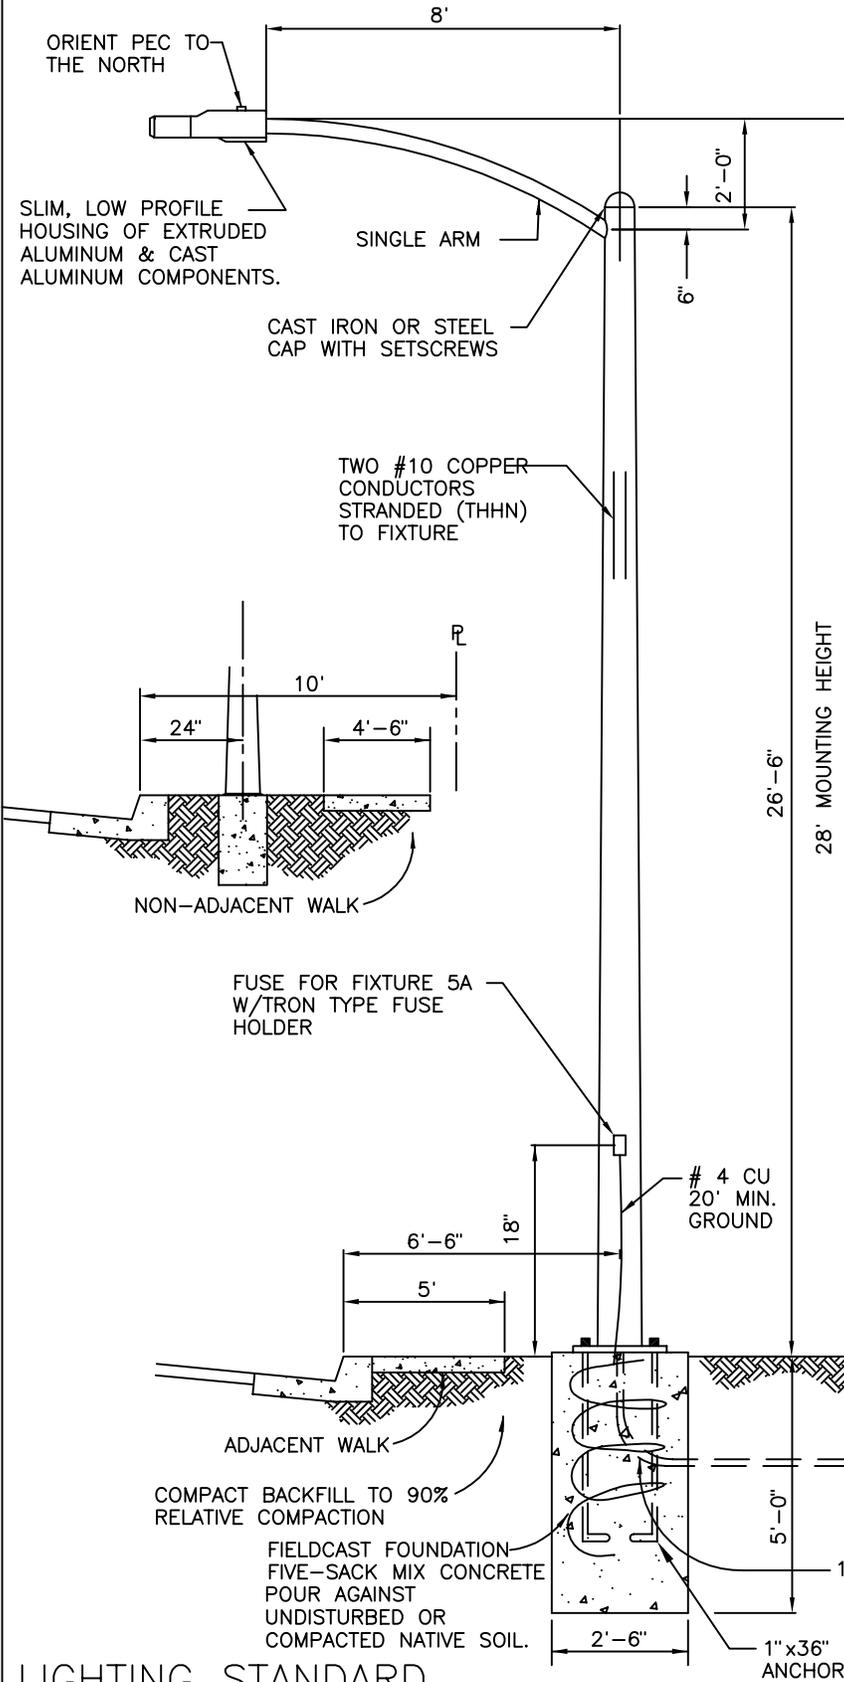

BASE PLATE DETAIL

SEE BASE DETAIL STD. E-2

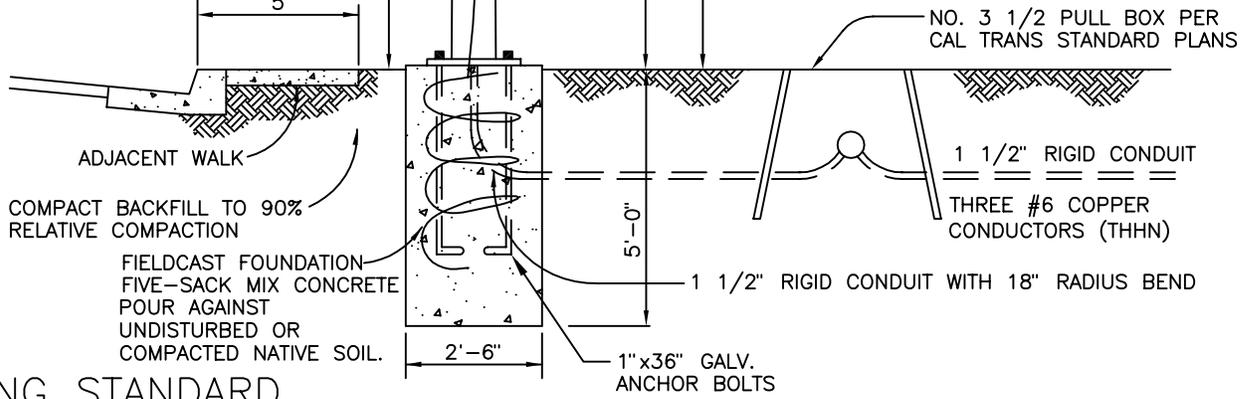

LIGHTING STANDARD
P.G.&E. 35-7274

| | | | |
|---|--|----------------|-------------------|
| STREETLIGHT-LOCAL STREET WITH BASE, PULL BOX & PVC CONDUIT | REVISIONS | CITY OF KERMAN | STD NO. E-1 |
| | 9-11-96 12-8-05 03-23-10 03-31-11 | | |