


FOUNDATION DETAIL

NOTES:

1. ALL WORK SHALL CONFORM TO THE NATIONAL ELECTRIC CODE, LATEST EDITION.
2. DECORATIVE STREETLIGHT SHALL CONSIST OF AN LED LUMINAIRE, FLUTED ALUMINUM POLE, CAST ALUMINUM BASE, AND RELATED ACCESSORIES AND SHALL BE MANUFACTURED BY HOLOPHANE, ANP LIGHTING OR APPROVED EQUAL.
3. LED LUMINAIRE SHALL HAVE WATTAGE EQUIVALENT TO 70 WATT HIGH PRESSURE SODIUM LUMINAIRE (FOR LOCAL STREETS). TYPE III OR TYPE V DISTRIBUTION, AS APPROPRIATE FOR LOCATION. WATTAGE FOR STREETLIGHTS TO BE INSTALLED ON COLLECTOR STREETS SHALL BE APPROVED BY THE CITY ENGINEER.
4. FOR LOCATIONS WITH SIDEWALK ADJACENT TO CURB, STREETLIGHT SHALL BE 18" BEHIND SIDEWALK. FOR LOCATIONS WITH SIDEWALK NON-ADJACENT TO CURB, OR NO SIDEWALK, STREETLIGHT SHALL BE 24" BEHIND THE FACE OF CURB.
5. STREETLIGHT PLAN, INCLUDING PHOTOMETRICS, SHALL BE SUBMITTED FOR REVIEW AND APPROVAL BY THE CITY ENGINEER.
6. ORIENTATE PHOTO ELECTRIC CELL (PEC) TO NORTH.

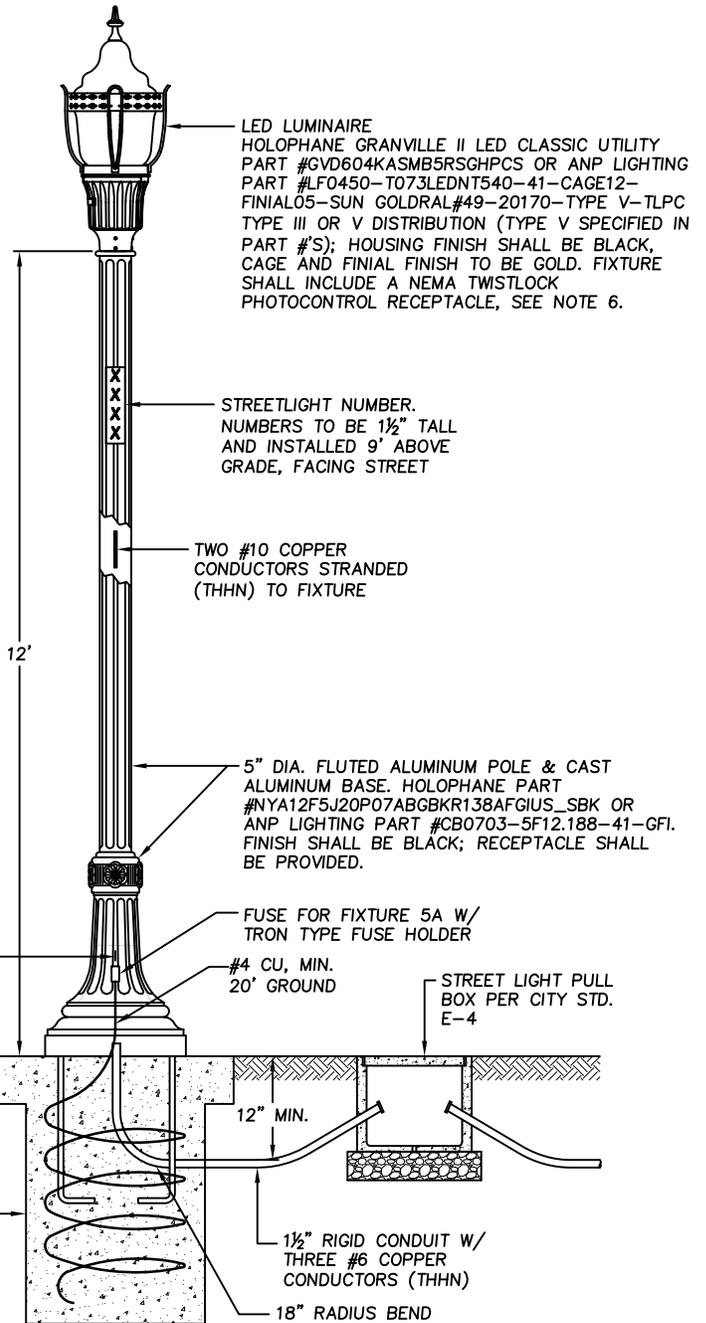

DECORATIVE STREETLIGHT

REVISIONS
10/06/14

CITY OF KERMAN

STD
NO.
E-9