



PLANS OF SIDEWALK, CURB & GUTTER, SCRIBE LINE DETAILS

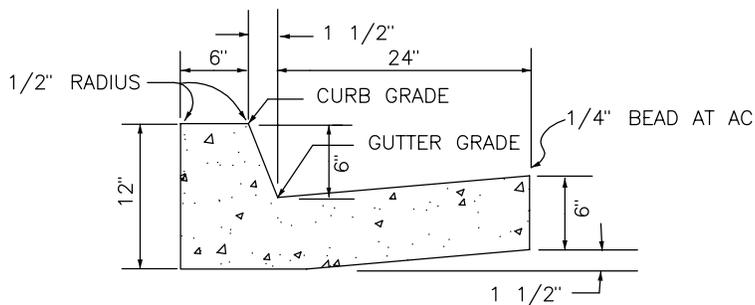


CURB & GUTTER

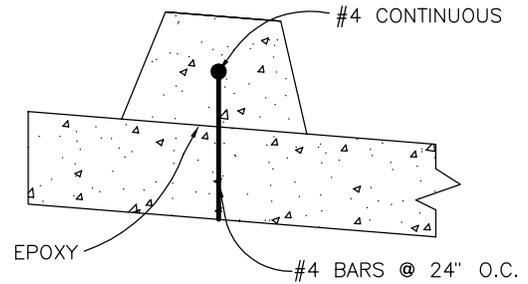

MEDIAN DOWELED CURBS
AS ALLOWED BY ENGINEER

NOTE:

1. CONTRACTOR SHALL FILL AREA BETWEEN NEW GUTTER AND EXISTING STREET SURFACE WITH MIN 2" A.C. AND 4" A.B. OR AS REQUIRED BY CITY ENGINEER TO MEET
2. EXISTING STREET SURFACE.
3. COMPACTION SHALL BE MADE TO THE SATISFACTION OF THE ENGINEER.
4. CONCRETE SHALL BE FINISHED WITH A "BROOM" FINISH.
5. MINIMUM GUTTER SLOPE = 0.15%

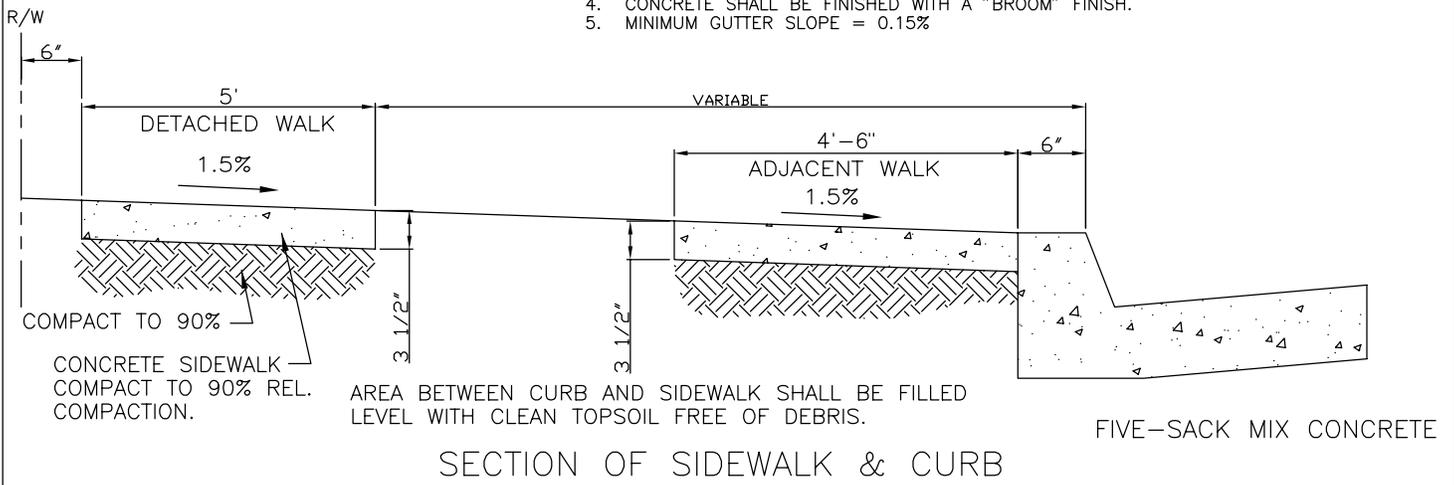

CONCRETE SIDEWALK,
CURB & GUTTER

REVISIONS
12-8-05
03-23-10
09-23-11

CITY OF KERMAN

STD.
NO.
P-5