


SEWER LATERAL ABOVE WATER MAIN

1. IF BOTH SEWER AND WATER ARE NEW CONSTRUCTION, WATER MAIN SHALL BE CLASS 200 PIPE WITH NO JOINTS WITHIN 10 FEET OF CROSSING.
2. IF ONLY WATER MAIN IS NEW CONSTRUCTION, WATER MAIN SHALL BE CLASS 200 PIPE, WITH NO JOINTS WITHIN 10 FEET OF CROSSING.
3. IF ONLY SEWER MAIN IS NEW CONSTRUCTION, SEWER PIPE 10 FEET ON EACH SIDE OF CROSSING SHALL BE DUCTILE IRON PIPE WITH FLANGED JOINTS, OR PVC ENCASED IN CONCRETE, MINIMUM THICKNESS OF 6 INCHES.

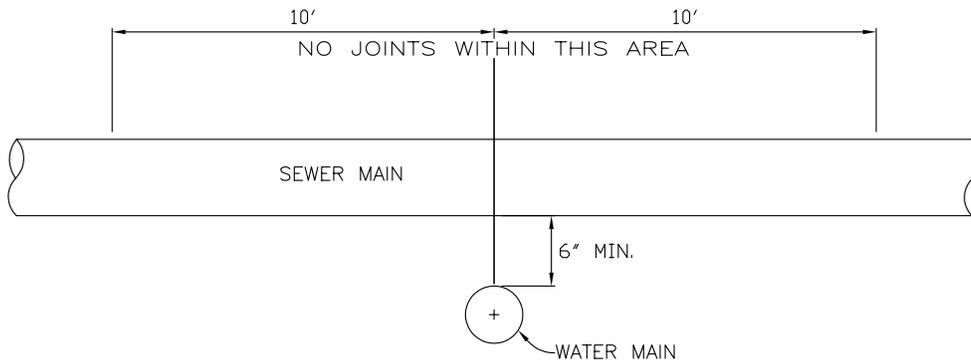

SEWER MAIN ABOVE WATER MAIN

SEWER SERVICE AND
WATER MAIN SEPERATION

REVISIONS
12-8-05

CITY OF KERMAN

STD.
NO.
S-1