


QUARTER TURNS TO BE CONSTRUCTED TO FORM A SMOOTH FLOW LINE OF SAME SHAPE AND PATTERN AS BOTTOM WALL OF PIPE.

BE LAID THROUGH MANHOLES WITH TOP HALF REMOVED AND ROUGH BROKEN EDGES MORTARED SMOOTH.

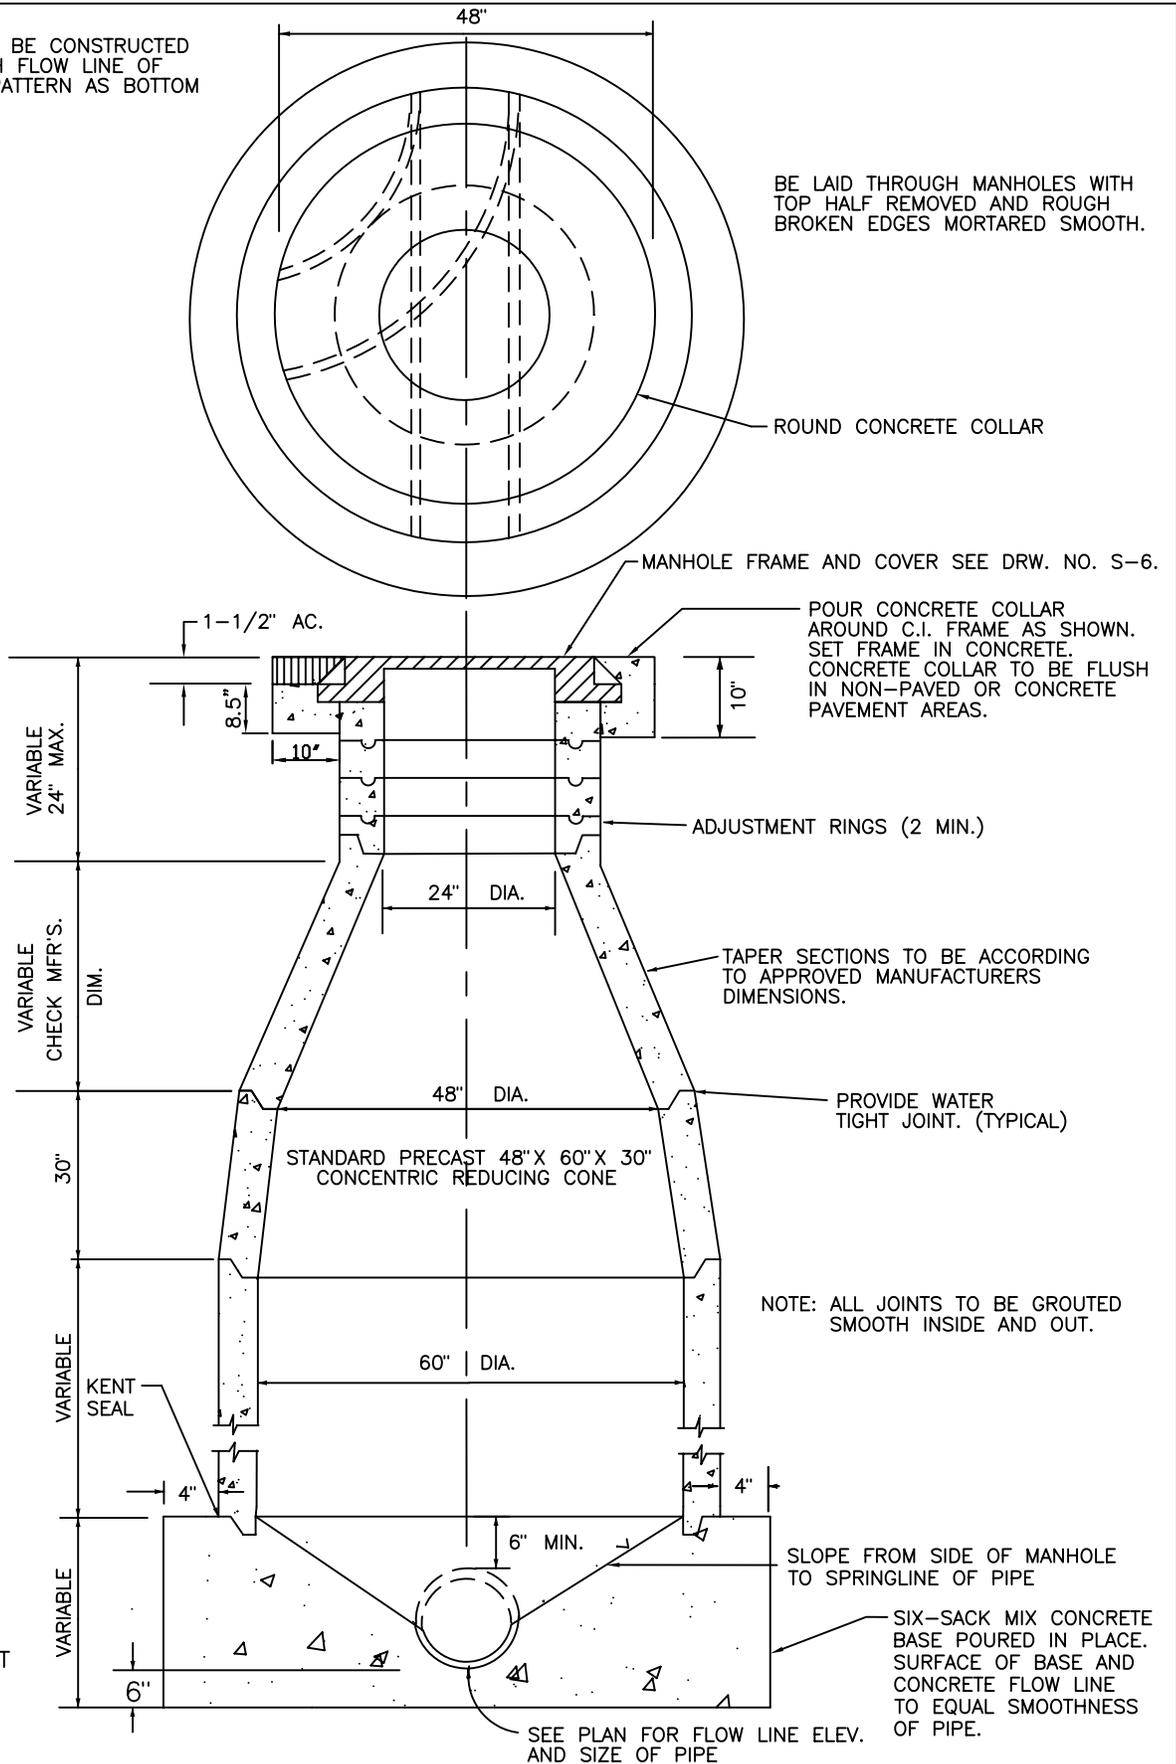

NOTE: PRECAST PIPE, ADJUSTMENT RINGS AND TAPERED SECTIONS SHALL BE CLASS II RCP IN ACCORDANCE WITH A.S.T.M. C76. ELLIPTICAL SINGLE LINE REINFORCEMENT WILL NOT BE PERMITTED.

# 60" SEWER MANHOLE WITH PRECAST SECTIONS & CAST IRON FRAME & COVER

REVISIONS  
09-11-96  
12-08-05  
03-23-10

CITY OF KERMAN

STD NO. S-4