


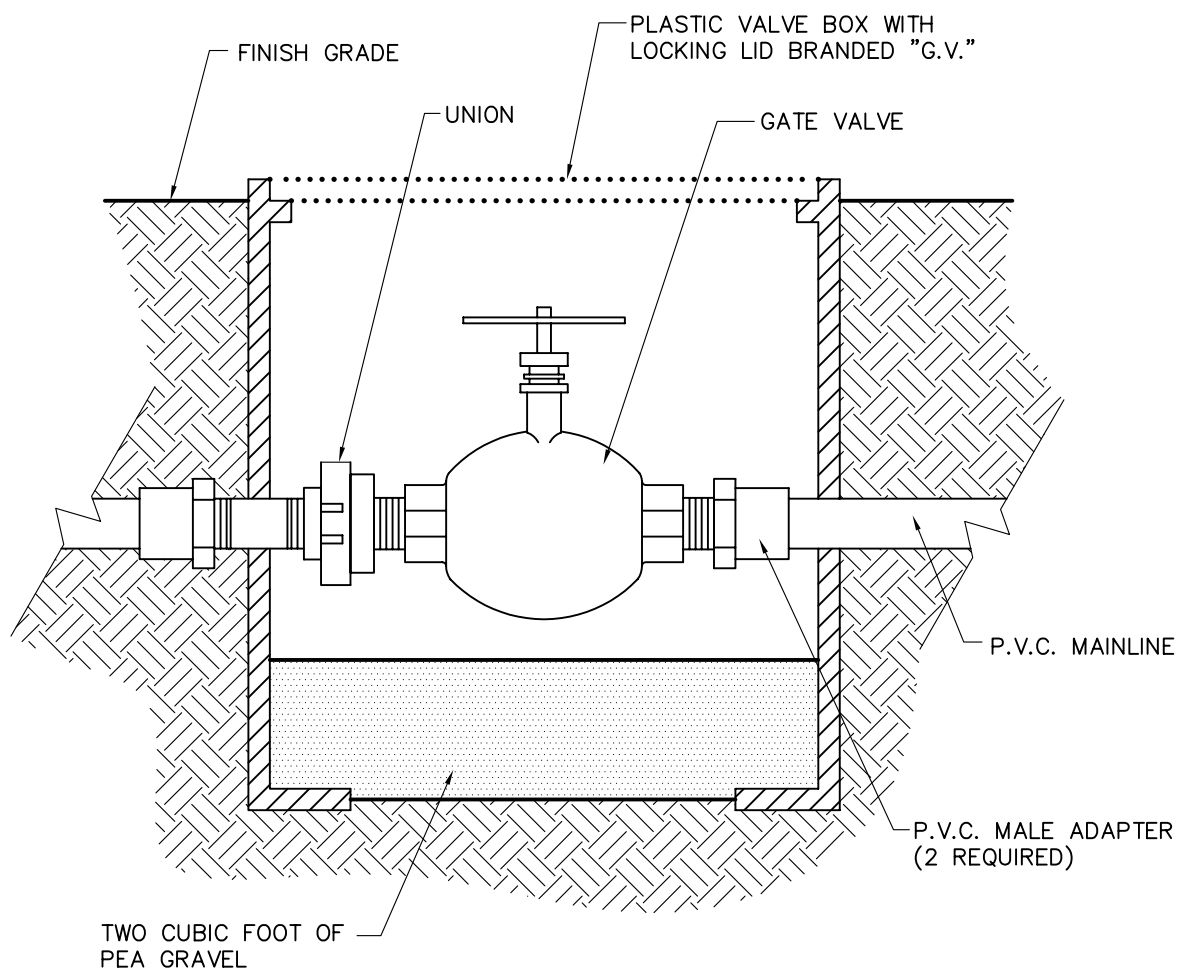

NOTE: INTALL VALVE BOX SO THAT THE TOP OF COVER IS 2" ABOVE FINISH GRADE IN GROUND COVER AREAS.

GATE VALVE

REVISIONS
1-05-06

CITY OF KERMAN

STD.
NO.
L-7