

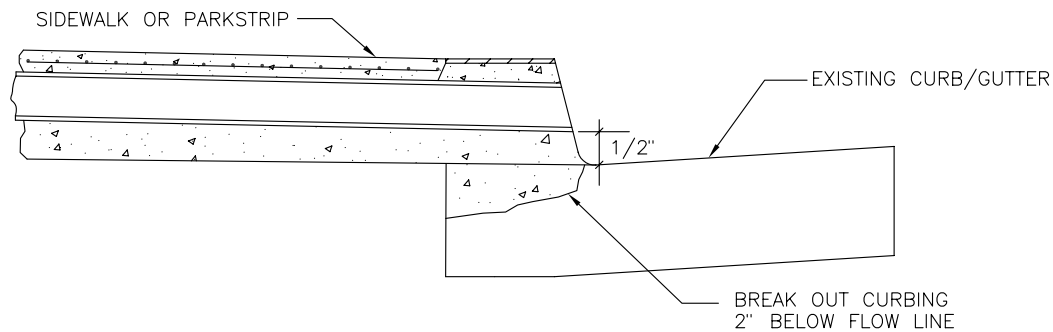


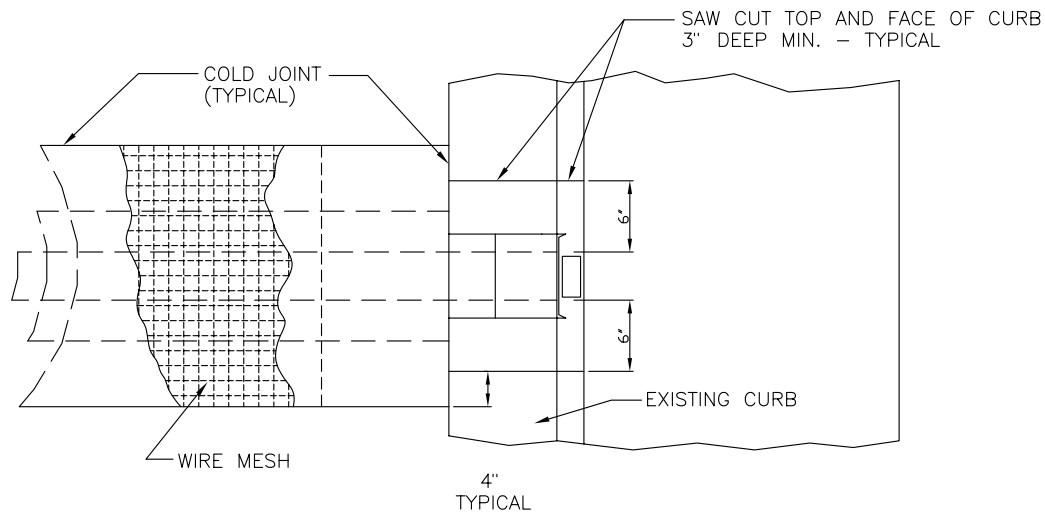

DRAINLINE INSTALLATION FOR EXISTING CURB & GUTTER

NOTES:

1. TUBES SHALL BE ONE CONTINUOUS LENGTH FROM PROPERTY LINE TO CURB LINE.
2. MULTIPLE TUBES TO BE SET A MINIMUM DISTANCE OF 4" APART. (SEE DETAIL BELOW)
3. CONCRETE SHALL BE 6 SACK MIX.
4. WIRE MESH TO BE INSTALLED IN CONCRETE ABOVE DRAIN LINE.
5. TUBES SHALL BE 3x4, 3x5 OR 3x6, 3/16" WALL THICKNESS

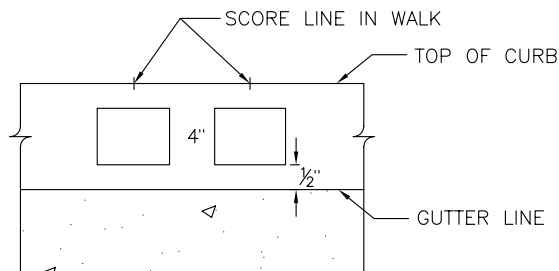

DUAL PIPE INSTALLATION

SIDEWALK UNDERDRAIN PIPE

REVISIONS
12-8-05
03-23-10

CITY OF KERMAN

STD
NO.
P-6