


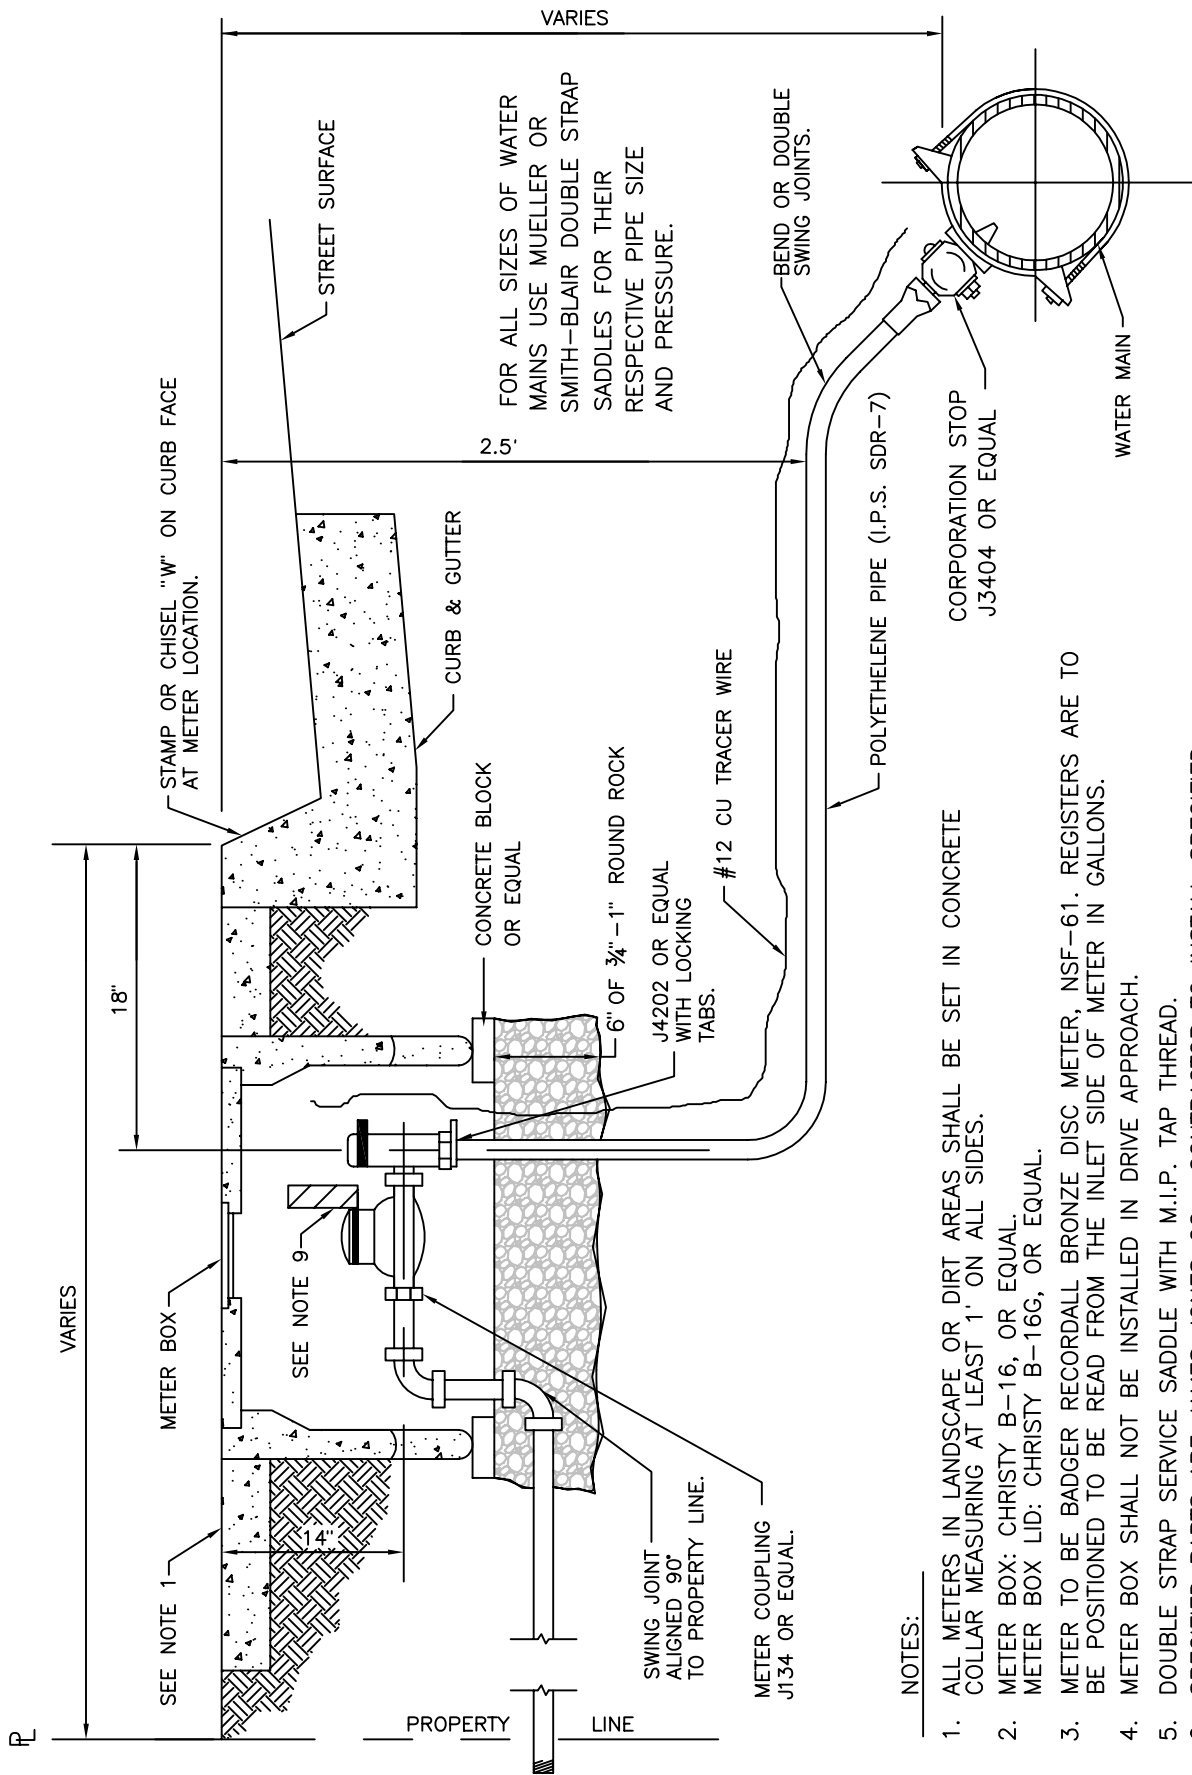

NOTES:

1. ALL METERS IN LANDSCAPE OR DIRT AREAS SHALL BE SET IN CONCRETE COLLAR MEASURING AT LEAST 1' ON ALL SIDES.
2. METER BOX: CHRISTY B-16, OR EQUAL.
METER BOX LID: CHRISTY B-16G, OR EQUAL.
3. METER TO BE BADGER RECORDALL BRONZE DISC METER, NSF-61. REGISTERS ARE TO BE POSITIONED TO BE READ FROM THE INLET SIDE OF METER IN GALLONS.
4. METER BOX SHALL NOT BE INSTALLED IN DRIVE APPROACH.
5. DOUBLE STRAP SERVICE SADDLE WITH M.I.P. TAP THREAD.
6. SPECIFIED PARTS ARE JAMES JONES CO. CONTRACTOR TO INSTALL SPECIFIED OR EQUAL PARTS.
7. ALL COMPRESSION JOINT FITTINGS TO USE STAINLESS STEEL INSERTS.
8. METER & REGISTER NUMBER MUST MATCH.
9. ORION RTR & INTEGRAL PIT TRANSMITTER.
10. FOR NON-FIRE SPRINKLERED DWELLINGS USE 3/4" X 9" METER.
FOR FIRE SPRINKLERED DWELLINGS USE 1" X 10-3/4" METER.

1" SERVICE CONNECTION

REVISIONS
09-22-11

CITY OF KERMAN

STD
NO.
W-2